
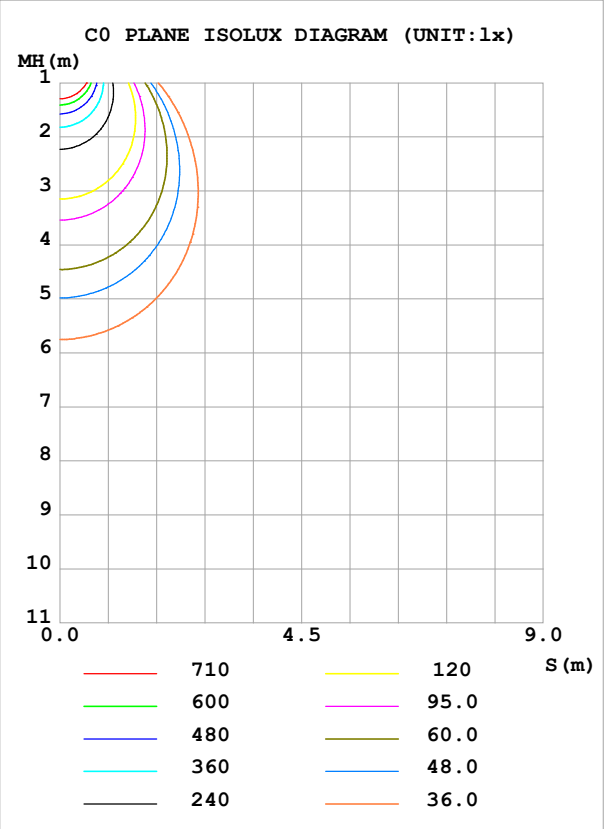


EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

LUMINAIRE PHOTOMETRIC TEST REPORT

Test:U:229.6V I:0.1173A P:25.1W PF:0.9305 Freq:50.01Hz		
UTHDi:0.00% ITHDi:0.00% KDisp:0Lamp Flux:3448.9x1 lm		
NAME: X500-457KA-9060 (25W 5700K)	TYPE:	WEIGHT:
SPEC.:	DIM.:	SERIAL No.:
MFR.:	SUR.:	Shielding Angle:

DATA OF LAMP		PHOTOMETRIC DATA				Eff: 137.63 lm/W
MODEL	/	Imax (cd)	1889	S/MH (C0/180)	1.20	
NOMINAL POWER(W)	/	LOR (%)	100.0	S/MH (C90/270)	1.05	
RATED VOLTAGE(V)	/	TOTAL FLUX(lm)	3448.9	η UP,DN (C0-180)	0.0,65.8	
NOMINAL FLUX(lm)	3448.9	CIE CLASS	DIRECT	η UP,DN (C180-360)	0.0,34.2	
LAMPS INSIDE	1	η up (%)	0.0	CIBSE SHR NOM	1.50	
TEST VOLTAGE(V)	/	η down (%)	100.0	CIBSE SHR MAX	1.50	

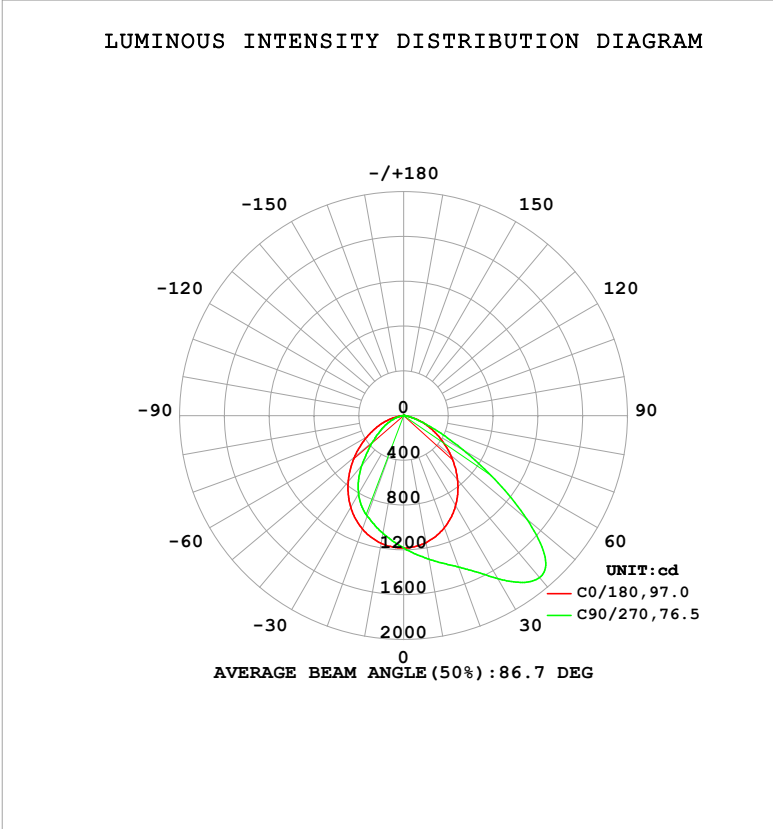

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3℃
Operators: HXL
Test Date: 2024-11-11

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.487
Humidity: 65.0%
Test Distance: 9.990m [K=1.0000]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

γ	C0	C45	C90	C135	C180	C225	C270	C315	γ	Φ zone	Φ total	%lum, lamp
10	1152	1251	1301	1253	1158	1089	1068	1087	0- 10	112.3	112.3	3.26,3.26
20	1066	1297	1440	1300	1079	975.9	953.2	971.0	10- 20	326.5	438.8	12.7,12.7
30	929.6	1342	1681	1339	946.4	842.9	807.0	834.9	20- 30	514.5	953.4	27.6,27.6
40	749.9	1445	1888	1431	771.5	675.0	585.3	659.3	30- 40	666.4	1620	47,47
50	549.8	1456	1435	1481	573.2	470.7	359.1	448.9	40- 50	730.2	2350	68.1,68.1
60	352.6	972.1	615.5	1055	378.5	268.8	212.3	249.9	50- 60	599.2	2949	85.5,85.5
70	182.6	390.4	183.7	455.4	206.8	128.0	101.9	114.6	60- 70	352.3	3301	95.7,95.7
80	31.56	68.75	40.60	91.36	48.69	30.39	15.26	21.09	70- 80	132.8	3434	99.6,99.6
90	1.130	0.7263	0.8877	1.065	0.9665	1.474	1.117	1.685	80- 90	14.68	3449	100,100
100									90-100			
110									100-110			
120									110-120			
130									120-130			
140									130-140			
150									140-150			
160									150-160			
170									160-170			
180									170-180			
DEG	LUMINOUS INTENSITY:cd									UNIT:lm		

Conical surface Flux(90deg): 1987.2 lm


%lum = 57.6%
%lamp = 57.6%

Conical surface Flux(120deg): 2949.2 lm

%lum = 85.5%
%lamp = 85.5%

C Range: 0 - 360DEG	γ Range: 0 - 90DEG
C Interval: 22.5DEG	γ Interval: 0.5DEG
Test Speed: HIGH	Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.487
Temperature:25.3℃	Humidity:65.0%
Operators:HXL	Test Distance:9.990m [K=1.0000]
Test Date:2024-11-11	Remarks:

LUMINANCE LIMITATION CURVES

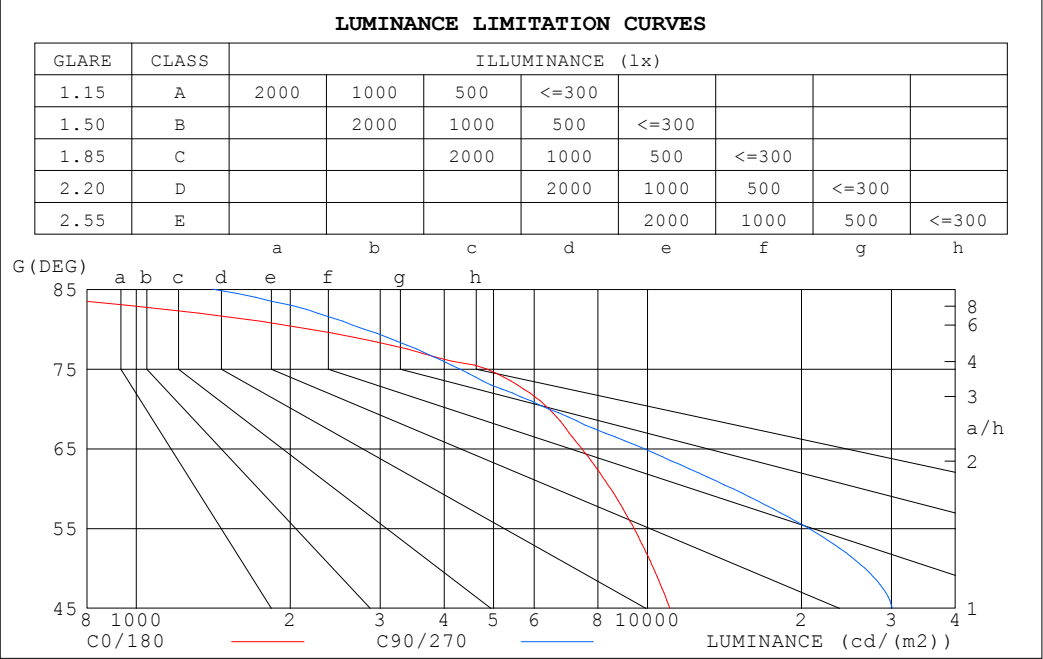


LUMINANCE cd/(m2)		
G (DEG)	C0/180	C90/270
85	418	1413
80	2184	2789
75	4844	4289
70	6414	6405
65	7439	9846
60	8473	14685
55	9418	20689
50	10278	26639
45	11064	30141

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:HXL
Test Date:2024-11-11

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.487
Humidity:65.0%
Test Distance:9.990m [K=1.0000]
Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

pcc	80%			70%			50%			30%			10%			0
pw	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
pfc	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio			Coefficients of Utilization(CU)												
0.0	1.19	1.19	1.19	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1.0	1.06	1.02	.98	1.03	.90	.97	.99	.96	.94	.95	.93	.91	.92	.90	.88	.86
2.0	.93	.86	.81	.91	.85	.80	.87	.83	.78	.84	.80	.77	.81	.78	.75	.73
3.0	.82	.74	.68	.80	.73	.67	.77	.71	.66	.75	.69	.65	.72	.68	.64	.62
4.0	.73	.64	.58	.71	.63	.57	.69	.62	.57	.67	.61	.56	.64	.59	.55	.53
5.0	.65	.56	.50	.64	.56	.49	.62	.54	.49	.60	.53	.48	.58	.52	.48	.46
6.0	.58	.50	.43	.57	.49	.43	.56	.48	.43	.54	.47	.42	.52	.47	.42	.40
7.0	.53	.44	.38	.52	.44	.38	.50	.43	.38	.49	.42	.37	.48	.42	.37	.35
8.0	.48	.40	.34	.47	.39	.34	.46	.39	.34	.45	.38	.33	.44	.38	.33	.31
9.0	.44	.36	.30	.43	.36	.30	.42	.35	.30	.41	.35	.30	.40	.34	.30	.28
10.0	.40	.33	.27	.40	.32	.27	.39	.32	.27	.38	.32	.27	.37	.31	.27	.25

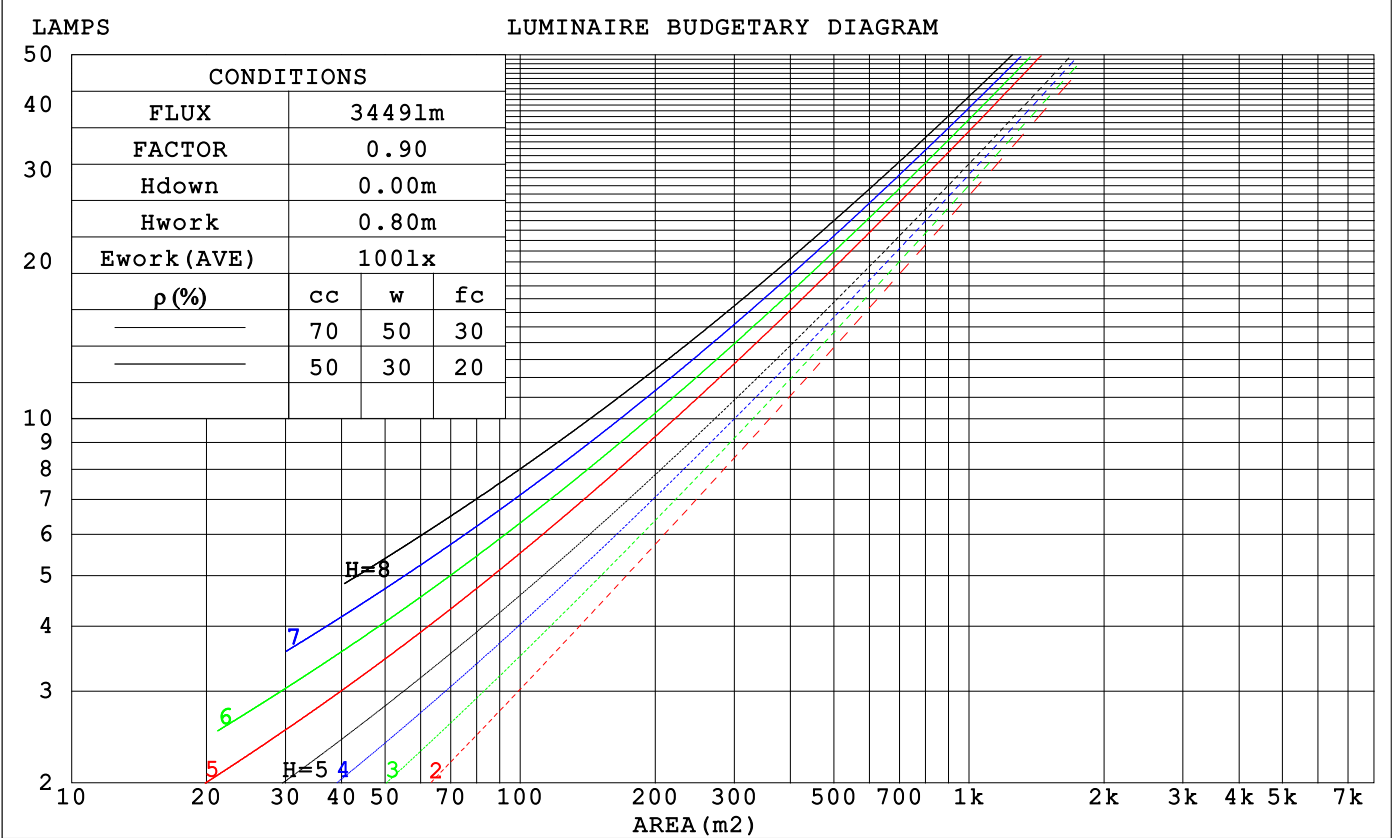

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:HXL
Test Date:2024-11-11

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.487
Humidity:65.0%
Test Distance:9.990m [K=1.0000]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

WEC AND CCEC

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Wall Exitance Coefficients (WEC)									
0.0																
1.0	.276	.157	.050	.269	.154	.049	.256	.147	.047	.244	.141	.045	.233	.135	.044	
2.0	.269	.147	.045	.263	.145	.045	.251	.140	.043	.241	.135	.042	.231	.131	.041	
3.0	.254	.135	.040	.249	.133	.040	.239	.129	.039	.229	.126	.039	.220	.122	.038	
4.0	.238	.124	.036	.233	.122	.036	.224	.119	.035	.216	.116	.035	.208	.113	.034	
5.0	.222	.113	.033	.218	.112	.033	.210	.109	.032	.203	.107	.032	.196	.104	.031	
6.0	.208	.104	.030	.204	.103	.030	.197	.101	.029	.190	.099	.029	.184	.097	.029	
7.0	.194	.096	.027	.191	.095	.027	.185	.093	.027	.179	.092	.027	.173	.090	.026	
8.0	.182	.089	.025	.179	.088	.025	.174	.087	.025	.168	.085	.025	.163	.084	.024	
9.0	.172	.083	.023	.169	.082	.023	.164	.081	.023	.159	.080	.023	.154	.078	.023	
10.0	.162	.078	.022	.159	.077	.021	.155	.076	.021	.150	.075	.021	.146	.074	.021	

ρ_{cc}	80%			70%			50%			30%			10%			0
ρ_w	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
ρ_{fc}	20%			20%			20%			20%			20%			0
RCR	RCR:Room Cavity Ratio						Ceiling Cavity Exitance Coefficients(CCEC)									
0.0	.190	.190	.190	.163	.163	.163	.111	.111	.111	.064	.064	.064	.020	.020	.020	
1.0	.178	.156	.137	.152	.134	.118	.104	.092	.082	.060	.053	.047	.019	.017	.015	
2.0	.169	.132	.101	.145	.114	.087	.099	.079	.061	.057	.046	.036	.018	.015	.012	
3.0	.161	.114	.077	.138	.099	.066	.095	.068	.047	.055	.040	.027	.018	.013	.009	
4.0	.154	.101	.060	.132	.087	.052	.091	.061	.037	.053	.036	.022	.017	.012	.007	
5.0	.147	.090	.048	.126	.078	.042	.087	.055	.030	.050	.032	.018	.016	.010	.006	
6.0	.140	.082	.040	.121	.071	.035	.083	.050	.025	.048	.029	.015	.016	.010	.005	
7.0	.134	.075	.034	.115	.065	.029	.080	.046	.021	.046	.027	.012	.015	.009	.004	
8.0	.128	.069	.029	.110	.060	.025	.076	.042	.018	.044	.025	.011	.014	.008	.004	
9.0	.122	.064	.025	.105	.056	.022	.073	.039	.016	.042	.023	.009	.014	.008	.003	
10.0	.116	.060	.023	.100	.052	.020	.070	.037	.014	.041	.022	.008	.013	.007	.003	

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators: HXL
 Test Date: 2024-11-11

γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.487
 Humidity: 65.0%
 Test Distance: 9.990m [K=1.0000]
 Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT

UGR(Unified Glare Rating) Table

ceiling/cavity		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
walls		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
working plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
x = 2H y = 2H	2H	22.1	23.7	22.5	24.0	24.3	24.3	25.9	24.6	26.2	26.5
	3H	23.4	24.8	23.8	25.2	25.5	24.6	26.1	25.0	26.4	26.7
	4H	23.7	25.1	24.1	25.4	25.8	24.7	26.0	25.1	26.4	26.7
	6H	23.8	25.0	24.2	25.4	25.8	24.7	25.9	25.1	26.3	26.6
	8H	23.8	24.9	24.2	25.3	25.7	24.6	25.8	25.1	26.2	26.6
	12H	23.7	24.9	24.2	25.2	25.7	24.6	25.7	25.0	26.1	26.5
	4H	2H	23.3	24.7	23.7	25.0	25.4	25.1	26.4	25.5	26.8
	3H	24.8	25.9	25.2	26.3	26.7	25.6	26.7	26.0	27.1	27.5
	4H	25.2	26.2	25.6	26.6	27.0	25.7	26.7	26.1	27.1	27.5
	6H	25.3	26.2	25.8	26.6	27.1	25.7	26.5	26.1	27.0	27.4
	8H	25.3	26.1	25.8	26.6	27.0	25.7	26.5	26.1	26.9	27.4
	12H	25.3	26.0	25.8	26.5	26.9	25.6	26.4	26.1	26.8	27.3
	8H	4H	25.3	26.1	25.8	26.5	27.0	25.9	26.7	26.3	27.1
	6H	25.5	26.1	26.0	26.6	27.1	25.9	26.6	26.4	27.0	27.5
	8H	25.5	26.1	26.0	26.6	27.1	25.9	26.5	26.4	27.0	27.5
	12H	25.5	26.0	26.0	26.5	27.0	25.9	26.4	26.4	26.9	27.4
	12H	4H	25.3	26.0	25.8	26.5	26.9	25.9	26.6	26.4	27.1
	6H	25.5	26.1	26.0	26.5	27.1	25.9	26.5	26.4	27.0	27.5
	8H	25.5	26.0	26.0	26.5	27.0	25.9	26.4	26.4	26.9	27.5
CIE190: 2010											

CIE190: 2010
Area: 0.08378 m2

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature:25.3℃
Operators:HXL
Test Date:2024-11-11

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.487
Humidity:65.0%
Test Distance:9.990m [K=1.0000]
Remarks:

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


UTILIZATION FACTORS TABLE

REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
ROOM INDEX	UTILIZATION FACTORS (PERCENT) $k(RI) \times RCR = 5$									
$k = 0.60$	58	47	40	57	46	40	56	46	40	33
0.80	69	58	50	68	57	50	66	56	50	43
1.00	78	67	60	77	67	60	75	68	60	53
1.25	85	75	69	84	75	68	81	73	68	61
1.50	90	81	75	89	80	74	86	79	73	66
2.00	97	89	83	95	88	83	92	86	81	74
2.50	101	94	88	99	92	87	95	90	85	77
3.00	104	98	93	102	96	92	98	93	89	81
4.00	108	102	98	105	101	97	101	97	94	86
5.00	110	105	102	107	103	100	103	100	97	88
ROOM INDEX	UF (total)									Direct
According to DIN EN 13032-2 2004			Suspended					SHRNOM = 1.25		

C Range: 0 - 360DEG
 C Interval: 22.5DEG
 Test Speed: HIGH
 Temperature: 25.3°C
 Operators: HXL
 Test Date: 2024-11-11


γ Range: 0 - 90DEG
 γ Interval: 0.5DEG
 Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.487
 Humidity: 65.0%
 Test Distance: 9.990m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

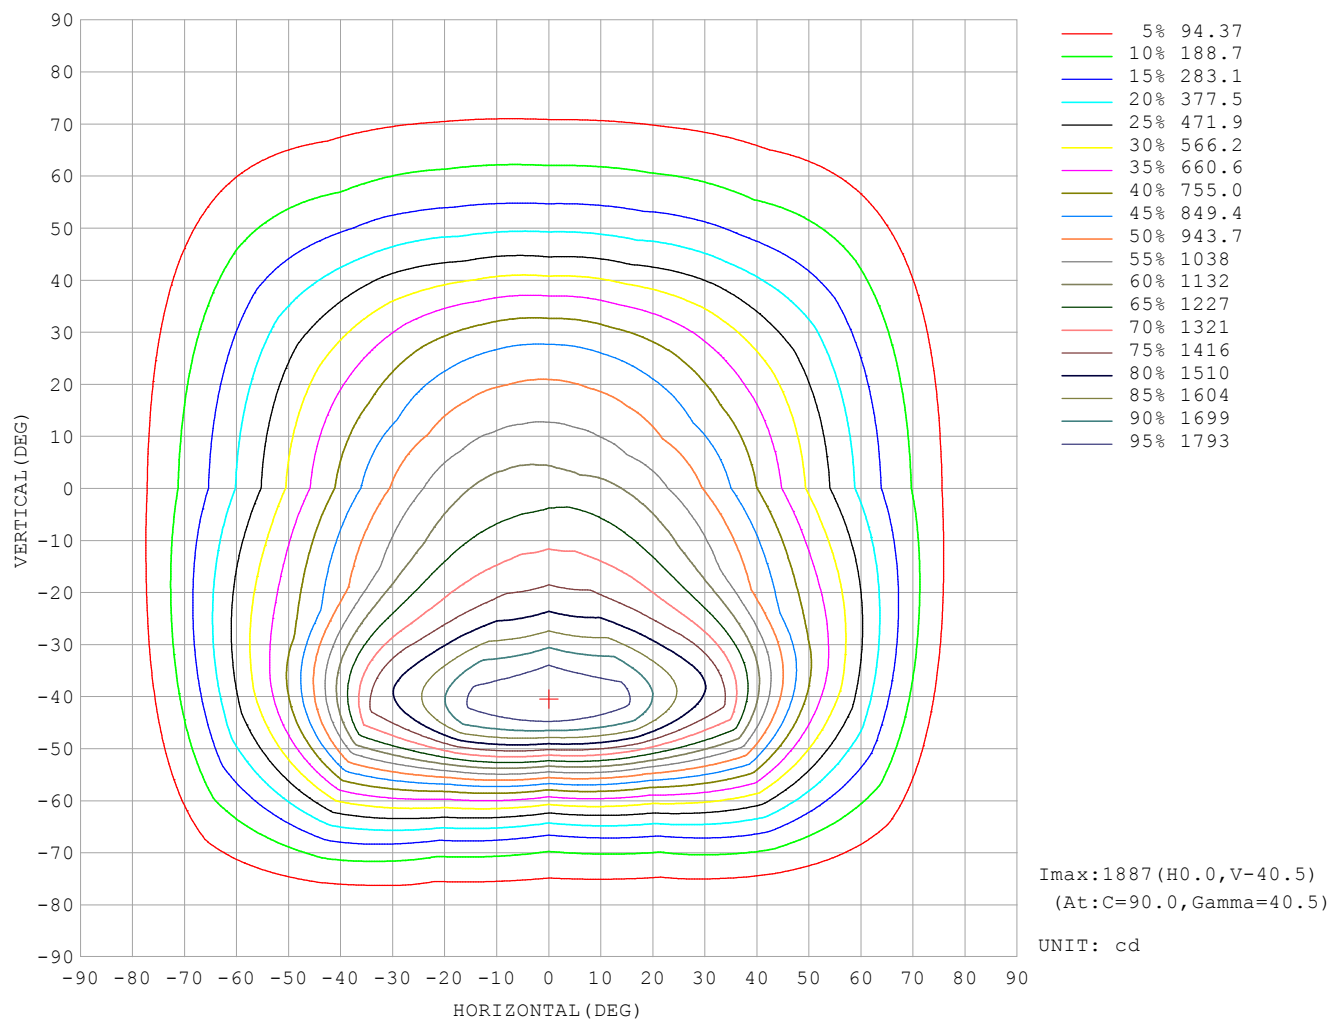

C Range: 0 - 360DEG	γ Range: 0 - 90DEG
C Interval: 22.5DEG	γ Interval: 0.5DEG
Test Speed: HIGH	Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.487
Temperature:25.3℃	Humidity:65.0%
Operators:HXL	Test Distance:9.990m [K=1.0000]
Test Date:2024-11-11	Remarks:


AAI Figure

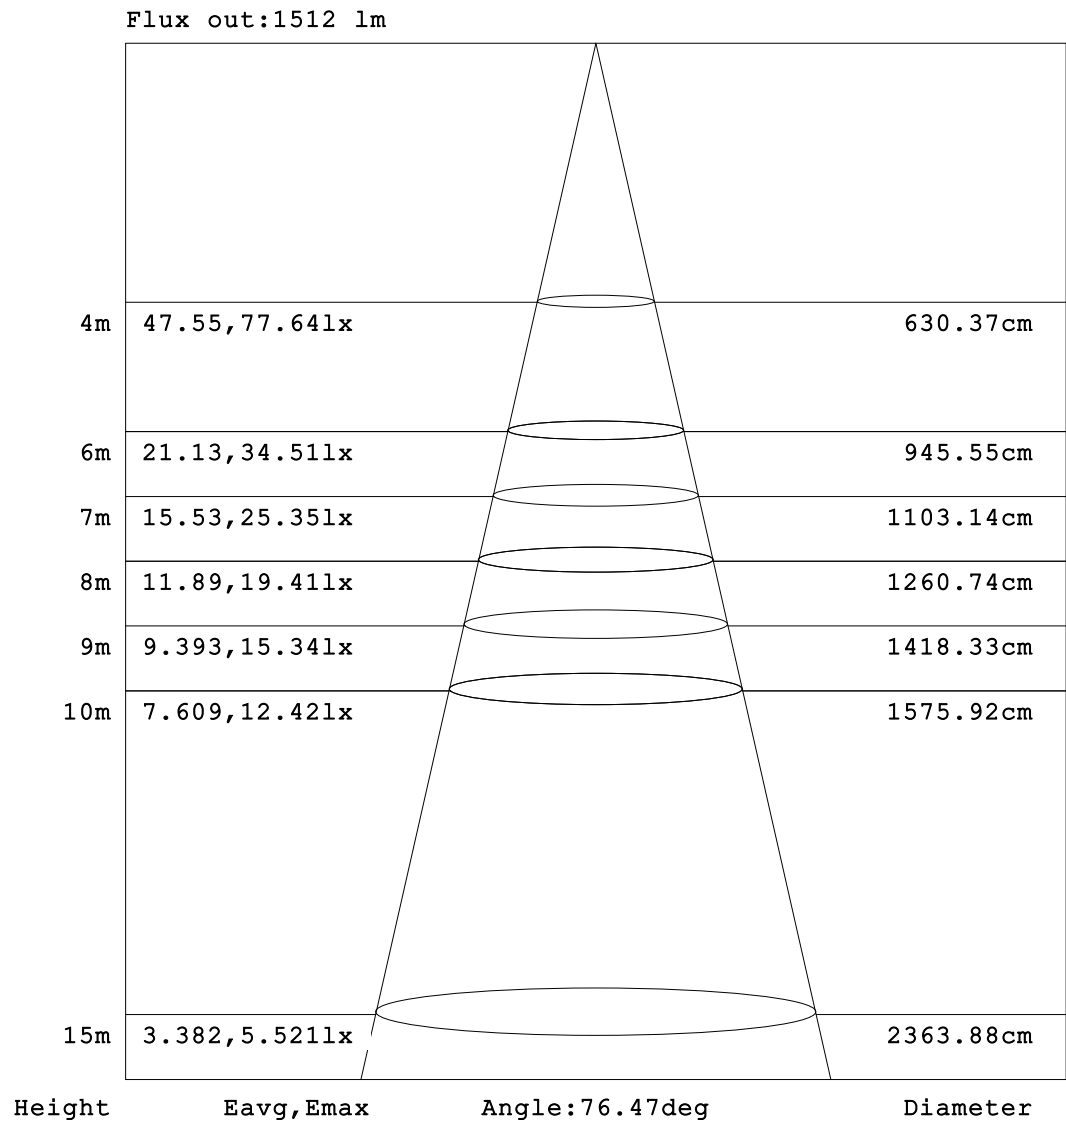

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

EVERFINE GONIOPHOTOMETERS SYSTEM TEST REPORT


ISOLUX DIAGRAM

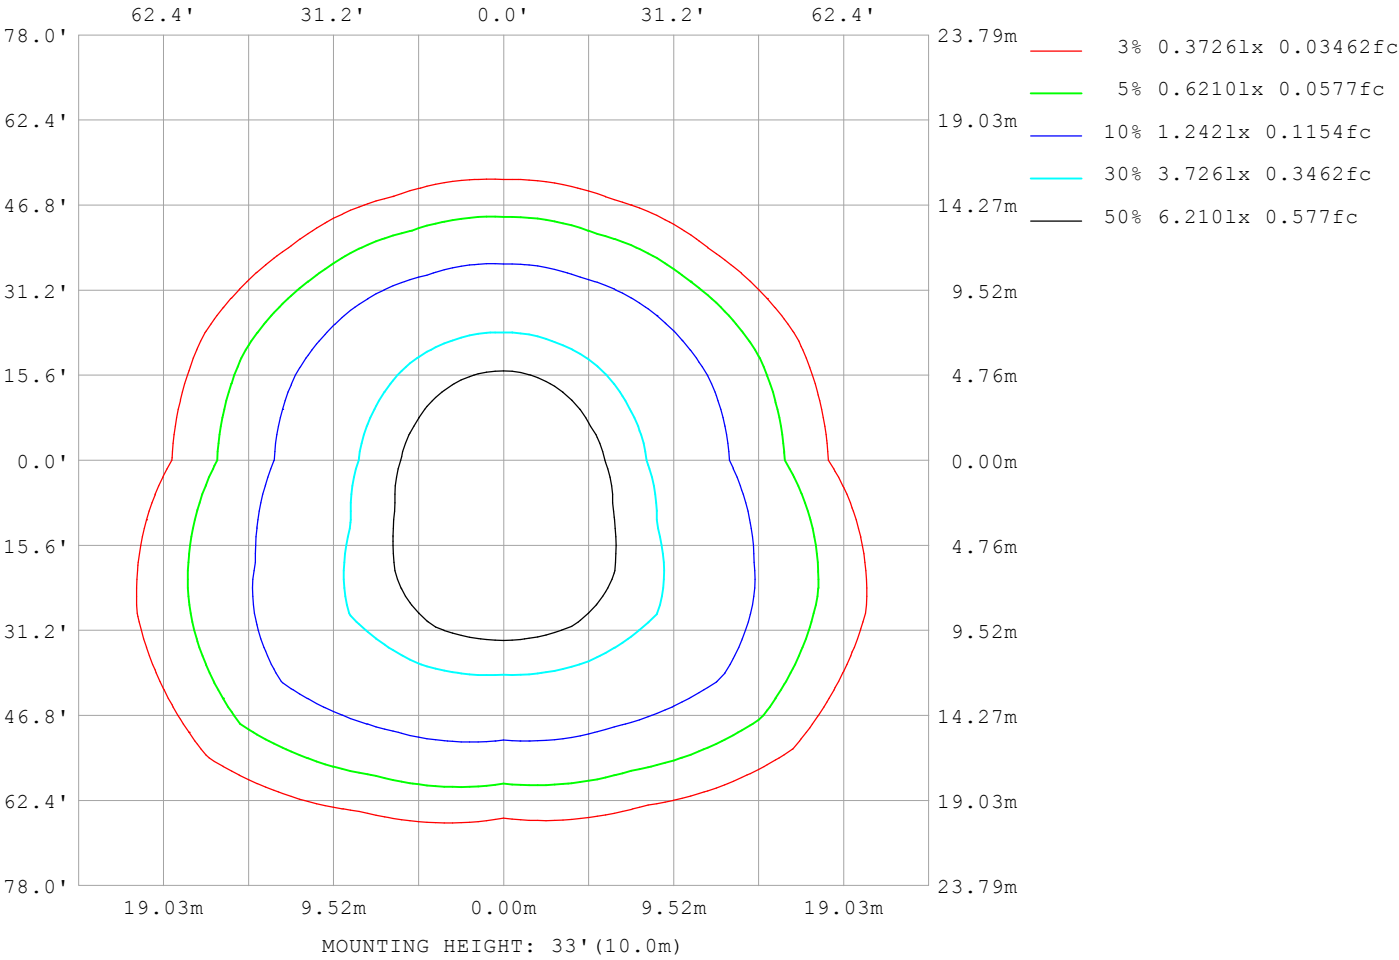

C Range: 0 - 360DEG
C Interval: 22.5DEG
Test Speed: HIGH
Temperature: 25.3°C
Operators: HXL
Test Date: 2024-11-11

γ Range: 0 - 90DEG
γ Interval: 0.5DEG
Test System: EVERFINE GO-2000A_V1 SYSTEM V2.00.487
Humidity: 65.0%
Test Distance: 9.990m [K=1.0000]
Remarks:

Planar Illuminance Curve

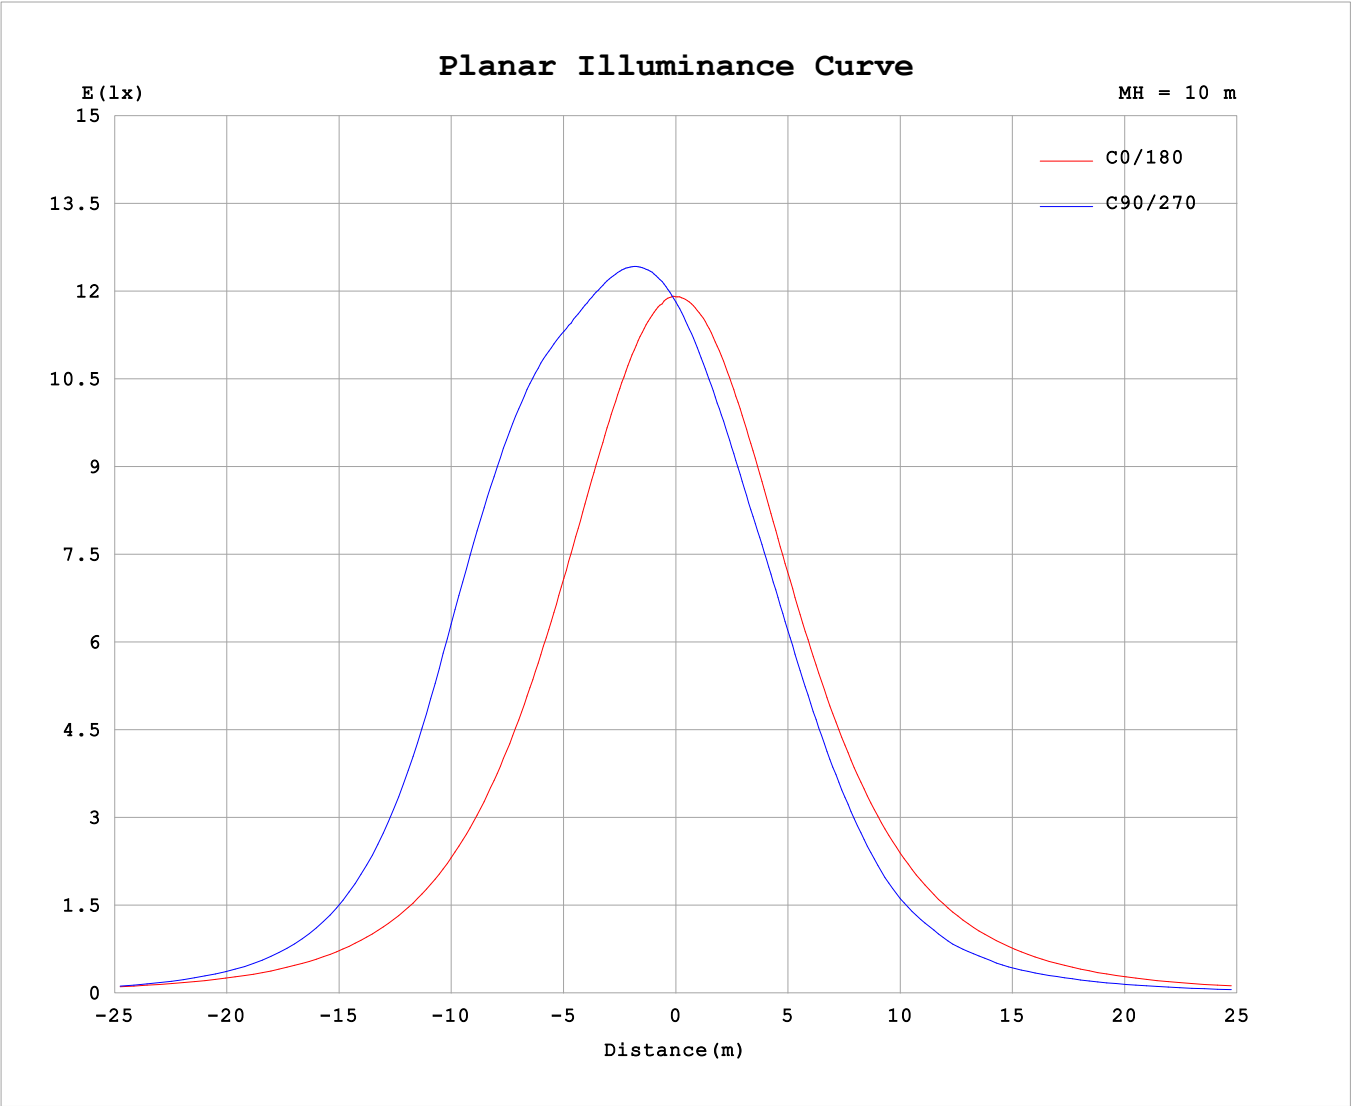

C Range: 0 - 360DEG	γ Range: 0 - 90DEG
C Interval: 22.5DEG	γ Interval: 0.5DEG
Test Speed: HIGH	Test System:EVERFINE GO-2000A_V1 SYSTEM V2.00.487
Temperature:25.3℃	Humidity:65.0%
Operators:HXL	Test Distance:9.990m [K=1.0000]
Test Date:2024-11-11	Remarks: